



Centurion
UNIVERSITY

*Shaping Lives...
Empowering Communities...*

Report on Bore well in CUTM Campuses

1. Paralakhemundi Campus:


Bore well No.	Location	Diameter (cm)	Depth (ft)	Pump Capacity (HP)	Discharge rate (lit/hr)	Daily working (hrs)	Daily Water supply (lit)
1	CPS-1	15.24	280	5	14000	3	42000
2	CPS-2	15.24	300	5	14000	3	42000
3	Hostel 3	12.70	260	3	3000	3	9000
4	STP 3 back side-1	15.24	290	5	14000	3	42000
5	STP 3 back side-2	15.24	280	5	14000	3	42000
6	Hostel 1	12.70	260	3	3000	3	9000
7	Old stage	15.24	280	5	14000	3	42000
8	Dhaba	15.24	300	5	14000	3	42000
9	CRC	15.24	280	5	14000	3	42000
10	Tribal village	15.24	300	5	14000	3	42000
11	Gate I	15.24	280	5	14000	3	42000
12	Near Playground-1	15.24	300	5	14000	3	42000
13	Near Playground-2	15.24	280	5	14000	3	42000
14	HPCL	12.70	260	3	3000	3	9000
15	MDC	12.70	260	3	3000	3	9000
16	MBA-1	12.70	280	3	3000	3	9000
17	MBA-2	12.70	280	3	3000	3	9000
					Total water Supply		516000



2. Bhubaneswar Campus:


Bore well No.	Location	Depth (ft.)	Pump Capacity (HP)
1	Boys Hostel -7	200	2
2	Boys Hostel -7	200	2
3	Power House	200	5
4	Old Store	200	2

5	Boys Hostel -6	200	2
6	Boys Hostel -3	200	1.5
7	Boys Hostel -2	200	2
8	Boys Hostel -1	200	1.5
9	Near Landry	200	2
10	Mess	200	2
11	Market complex	200	2
12	Girls Hostel 1	200	1.5
13	Girls Hostel 2	200	1.5
14	Swimming Pool	200	2
15	Ground	200	2
16	Work Shop	200	1.5
17	Main Gate	200	1.5
	Daily Total water Supply (lit)	416000	



Ground Water Distribution
 Centurion University, Bhubaneswar, Jatni, Odisha 752050,
 India
 Lat 20.176414°
 Long 85.705118°
 03/06/22 10:41 AM

GPS Map Camera

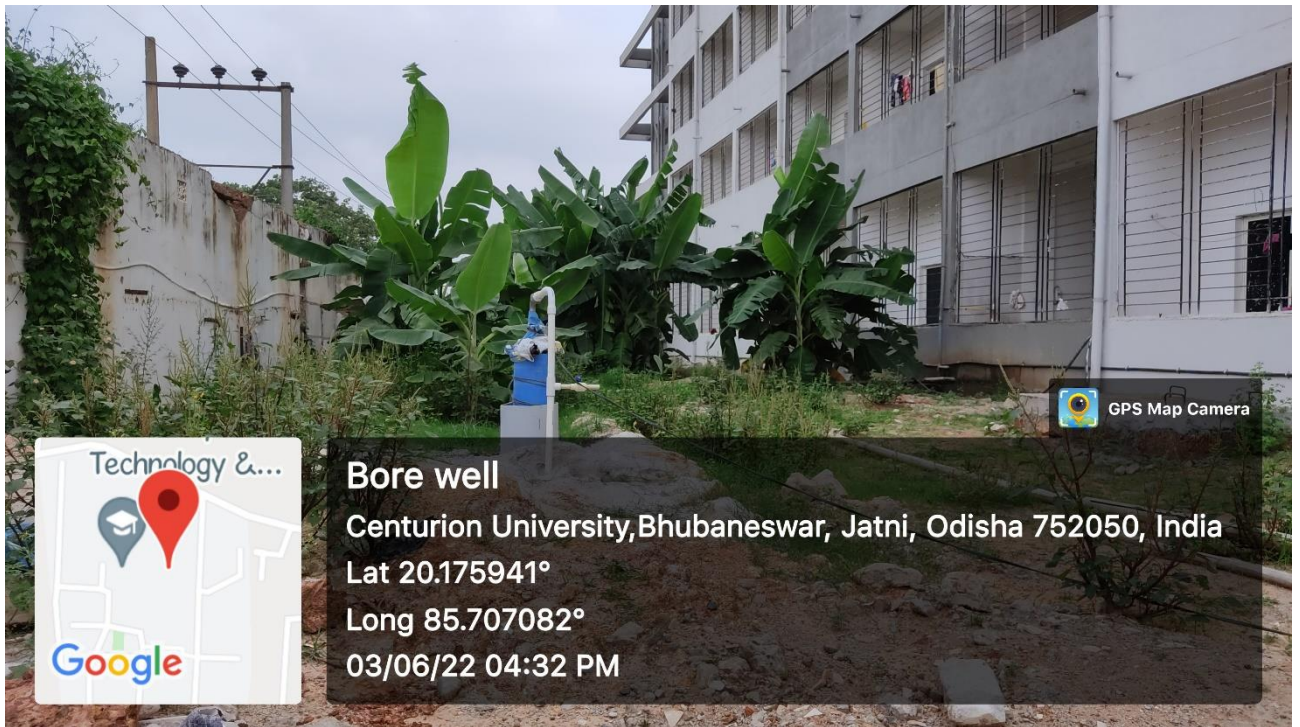

3. Rayagada Campus:

Bore well No.	Location	Diameter (cm)	Depth (ft.)	Pump Capacity (HP)	Discharge rate (lit/hr)	Daily working (hrs.)	Daily Water supply (lit.)
1	Near New Building	12.7	180	1.5	3700	1	4000
2	Near Old Building	12.7	180	1.5	5000	2	4000
3	Near garden	12.7	180	2.0	7200	6	33000
Total water Supply							41000



4. Bolangir Campus:

Bore well No.	Location	Diameter (cm)	Depth (ft.)	Pump Capacity (HP)	Discharge rate (lit/hr)	Daily working (hrs.)	Daily Water supply (liters)
1	Near Mini Canteen area	15.24	400	1.5	3000	6	18000
2	Near Forest Area	15.24	320	1.0	2500	3	7500
3	Near Academic Building (backside)-2	15.24	400	1.0	3500	5	17500
4	Near Pearl Culture area- 2	15.24	280	1.0	3500	6	21000
						Total water Supply	64000



Anita Patra

Registrar, CUTM

REGISTRAR
Centurion University of
Technology & Management
ODISHA